

**NOTES**

- PANEL SPECIFICATIONS:  
NEMA 4X ENCLOSURE  
CONTROL/ALARM SECTION  
VOLTAGE: 120 VAC  
BEACON VOLTAGE: 25 W MAX  
PUMP SECTION  
VOLTAGE: 120/208/240 SINGLE PHASE
- DASHED LINES REPRESENT FIELD WIRING REQUIRED.
- CONNECT GROUND TERMINAL IN BOX TO A GOOD GROUND.

*PRELIMINARY  
NOT RELEASED TO PRODUCTION*


ENCL	BP	ENVLPR
LIT	LBLS	PKG

REV	ECD NO.	DATE	DRWN	APPD	NOTICE: THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND IT SHALL NOT BE USED OR REPRODUCED OR ITS CONTENTS DISCLOSED IN WHOLE OR IN PART, WITHOUT PRIOR WRITTEN CONSENT.	DRWN BY MCH	DATE 1/11/05	CHKD BY	DATE	APPD BY	DATE	PROJECT NO. LSC12	QUOTE NO. N/A	REV. A	
						DRW NAME N/A		DRW P/N N/A		PAGE 1 of 3	SCALE NONE	DWG SIZE D	TITLE SUBMITTAL SCHEMATIC		

**SJE Rhombus**  
CONTROLS

201  
202  
203  
204  
205  
206  
207  
208  
209  
210  
211  
212  
213  
214  
215  
216  
217  
218  
219  
220  
221  
222  
223  
224  
225  
226  
227  
228  
229  
230  
231  
232  
233  
234  
235  
236  
237  
238  
239  
240  
241

PRELIMINARY  
NOT RELEASED TO PRODUCTION

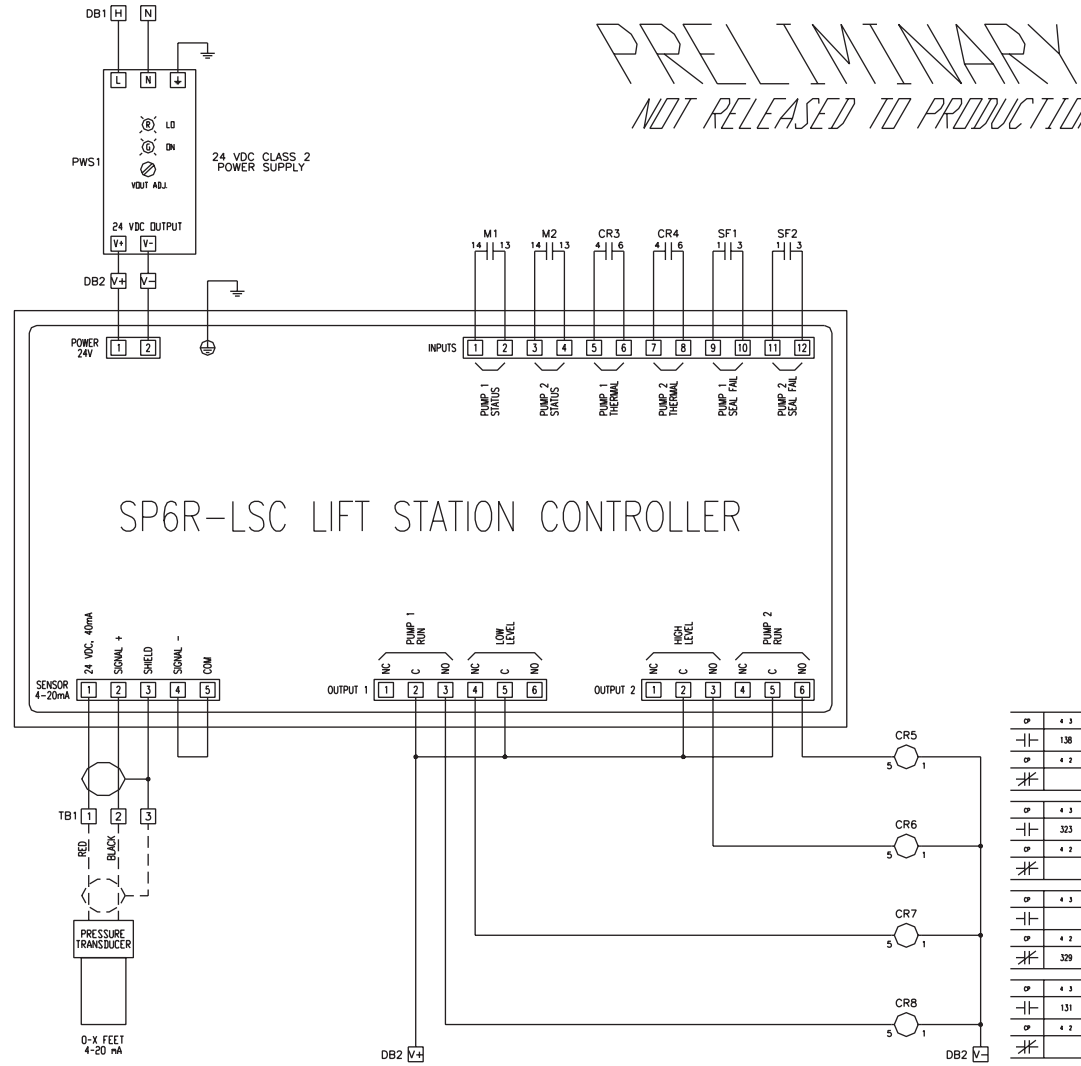

□	+ 3
⊖	138
□	+ 2
⊖	323
□	+ 2
⊖	329
□	+ 3
⊖	131
□	+ 2

REV. DATE					NOTICE: THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND IT SHALL NOT BE USED OR REPRODUCED OR ITS CONTENTS DISCLOSED IN WHOLE OR IN PART, WITHOUT PRIOR WRITTEN CONSENT.					PROJECT NO. LSC12			QUOTE NO. N/A	REV. A	
REV.	ECD NO.	DATE	DRWN	APPD	DRWN BY MCH	DATE 1/11/05	CHD BY	DATE	APPD BY	DATE	PAGE 2 of 3	SCALE NONE	DWG SIZE D	TITLE SUBMITTAL SCHEMATIC	



