

# CP3R Quick Start Manual




## for Constant Pressure Applications

This CP3R Drive has been factory pre-programmed for your specific pressure control application.

All relevant parameters have been configured to match the provided pump data and system pressure requirements.

Should you need to make minor adjustments, please consult the parameter table enclosed in this document.


Consult the factory for assistance.

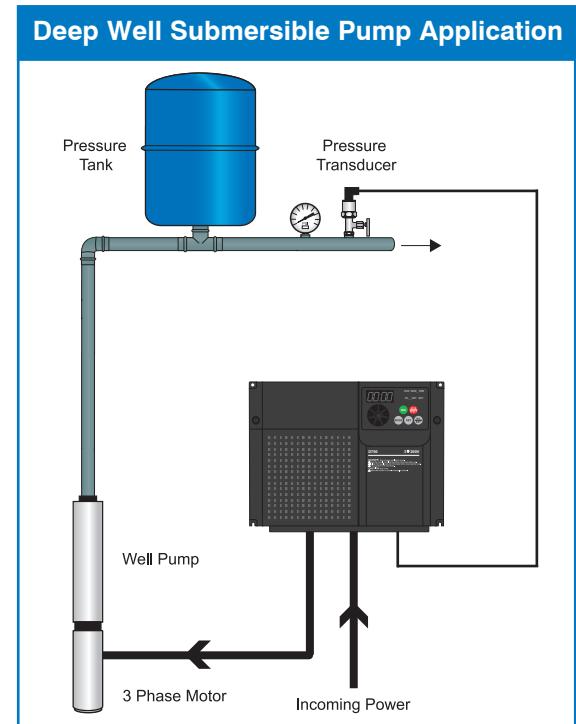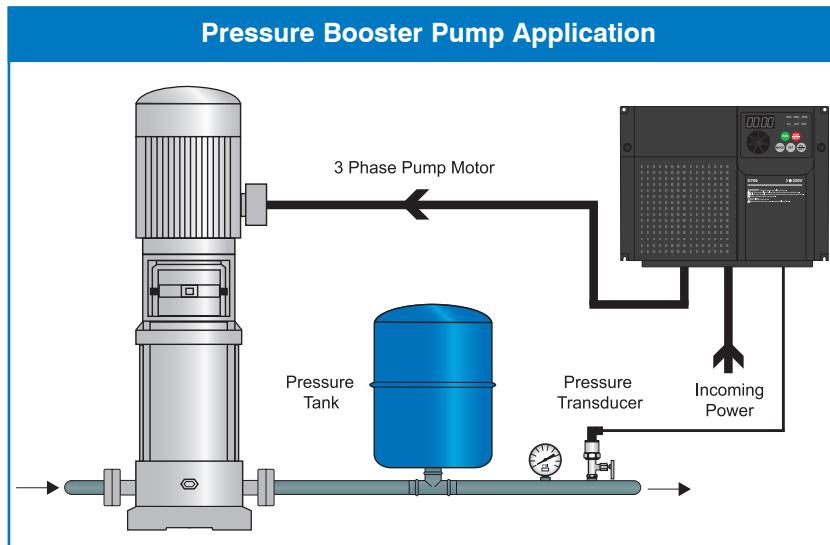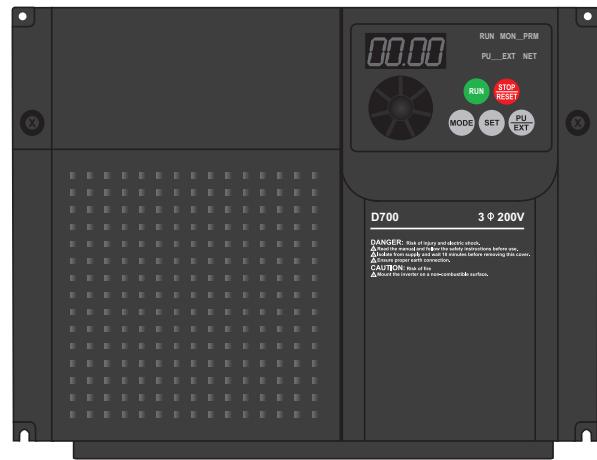

## Display and Keypad —

## DISPLAY:

## Monitor 4 digit LED

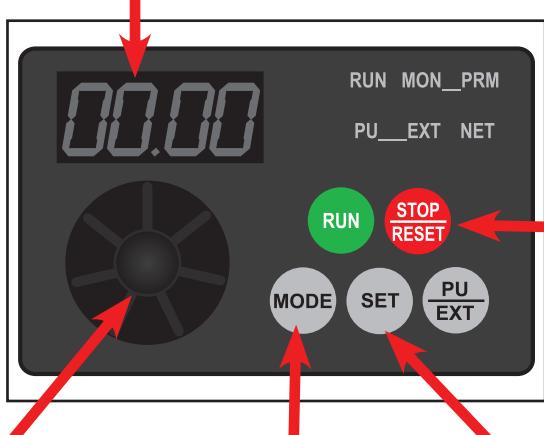

**SETTING DIAL:** Used to scroll through parameter list and edit parameter value.

**MODE:** To display parameters. Also used to exit back to monitoring display.

**SET:** Used to save parameter value after editing. During operation the SET button is used to monitor motor Hz, amps and pump discharge pressure.

## Monitoring Hz, Amps and PSI

Press the SET button to toggle the display from:

- Motor speed (Hz ON)
- Motor Amps (A ON)
- Pressure (Hz, A & V OFF)

**STOP/RESET:**  
Fault RESET

## PARAMETERS DESCRIPTION

## Example: Changing the Set Pressure

1. Press **MODE** to choose the parameter setting mode.



2. Turn the **SETTING DIAL** until P.133 (Pr. 1) appears.



3. Press **SET** to read the current pressure set point value. “50.00” (initial value) appears.



4. Turn the **SETTING DIAL** to change it to the pressure set point value “55.00”.



5. Press **SET** to save. **Flash --- Parameter setting complete!**



- Turn **SETTING DIAL** to read another parameter
- Press **SET** to show the setting again.
- Press **SET** twice to show the next parameter.
- Press **MODE** twice to return the monitor to frequency monitor.


# OFF/AUTO Operation —

## OFF position

The pump will not run

## AUTO position

The pump will not run if the pressure is above the set pressure. The pump will run if the pressure drops below the Set Pressure less the Start Pressure. Example if set the set pressure is 40PSI (P.133=40 PSI), and the Start Pressure is 5PSI (P.577=1005). The pump will start when the pressure drops below 35PSI (see example below)

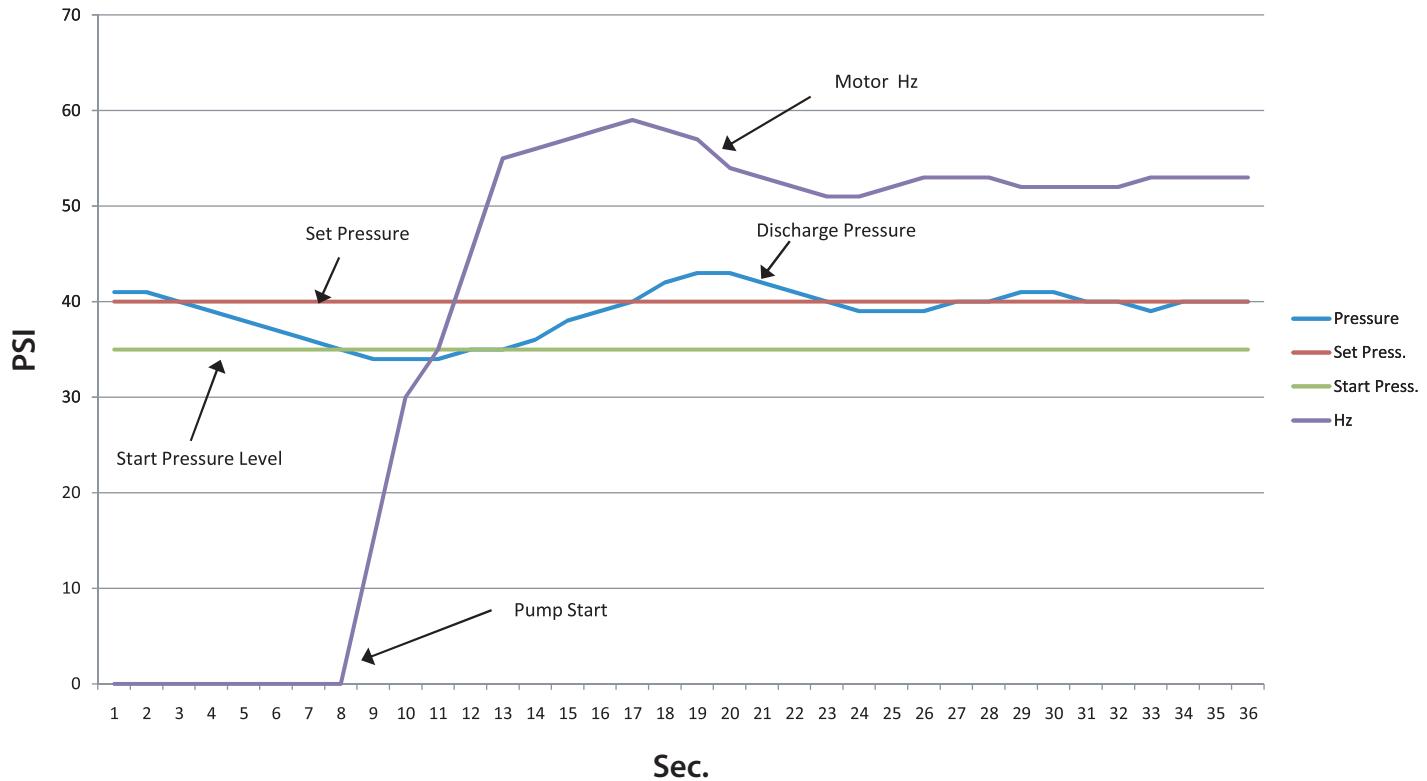

## High Pressure Shutdown

A normally closed pressure switch is highly recommended to be wired to the "High Pressure Shutdown" terminals in the CP3R panel. The pressure switch should be sized so that the normally closed contacts will open when the system pressure exceeds approximately 10-15 psi above the system setpoint pressure. The high pressure shutdown is intended to shut the CP3R panel down in the event of a transducer malfunction. Upon a drop in pressure, the CP3R panel will return to normal operation. A pressure relief valve is also highly recommended.

## Parameter List

PARAMETERS	DESCRIPTION	RANGE	DEFAULT	TYPICAL
P. 1	Maximum frequency	0 to 120Hz	60.00Hz	60.00Hz
P. 2	Minimum frequency	0 to 120Hz	30.00Hz	30.0Hz
P. 7	Accel time	0 to 3600s	2.0	2.0
P. 8	Decel time	0 to 3600s	2.0	2.0
P. 9	Electronic Thermal Overload	0 to 500A	--	Match Pump FLA
P. 83	Motor Voltage	0 to 1000V	230.0	Match Pump Volt
P. 129	PID proportional band	0.1 to 1000%, 9999	100%	100%
P. 130	PID integral time	0.1 to 3600s, 9999	1.0	1.0
P. 133	PID Pressure set point	0 to 100%, 9999	60.00	60.00
P. 575	Sleep timer	0 to 3600s, 9999	10.0	10.0
P. 576	Sleep Frequency	0 to 400Hz	35.00Hz	35.00Hz
P. 577	Start Pressure (differential)	900 to 1100%	1005	1005

### Maximum frequency: (P.1)

The pump will not be allowed run above this frequency. It must be set at 60Hz for most applications.

### Minimum frequency: (P.2)

The pump will not be allowed run below this frequency. It must be set at 30Hz for submersible well pumps.

### Acceleration/Deceleration time: (P.7, P.8)

P.7 Acceleration rate in seconds

P.8 Deceleration rate in seconds

Applicable to the Acceleration/Deceleration rate from 0Hz to 60Hz. Typically for submersible motors/pumps, the Accel/Decel time should be set to 2 seconds.

### Electronic thermal O/L relay: (P.9)

The electronic overload will trip the VFD and protect the motor from damage in the event an overload condition. Set this value to match the motor nameplate Full Load Amps. For submersible well pumps, set to the motor Max. Amps (Service Factor Amps).

### Motor Voltage: (P.83)

P.83 Voltage rating of pump motor.

# Parameter List —

## PID: (P.133, P.129, P130)

**P.133** is the **Pressure Set Point** (target pressure to be maintained at pump discharge). It cannot exceed the range of the pressure transducer (typically 0-100PSI).

**P.129** is the **Proportional Band**. For advanced users only.

This parameter is used for adjusting the frequency output control reaction to pressure changes. Decrease for larger (faster) corrections. Default is 100%. Decrease if large pressure overshoots on start up occurs.

**P.130** is the **Integral Time**. For advanced users only.

This parameter is used for adjusting the frequency output control reaction to pressure changes. Decrease for larger (faster) corrections. Default is 1 sec. Decrease for faster response, increase if quick unstable oscillations occur.

## Sleep Mode: (P.575, P.576, P577)


**P.575** is the **Sleep Timer**. This timer starts when the VFD output frequency drops below the Sleep Frequency (P.575). The pump will go to sleep (pump stopped) when this timer is done (typically 10Sec).

**P.576** is the **Sleep Frequency**. The Sleep Timer (P.575) starts the VFD output frequency drops below this frequency (typically 35Hz).

**P.577** is the **Start Pressure (Differential)**. The pump will start if the pressure drops below the Set Pressure less the Start Pressure. **Example:** If set the Set Pressure is 40PSI (P.133=40 PSI), and the Start Pressure is 5PSI (P.577=1005, the pump will start when the pressure drops below 35PSI (see example on page 3.) Typically set to 1005 (5PSI).

### Notes:

If the system cycles on and off too frequently try the following: increase the Sleep Timer (P.575), or lower the Sleep Frequency (P.576) or increase the Start Pressure (P.577). A combination of change in all three parameters may be necessary. If the pump does not go to sleep when there is no water demand (no flow), the Sleep Frequency (P.576) must be increased.

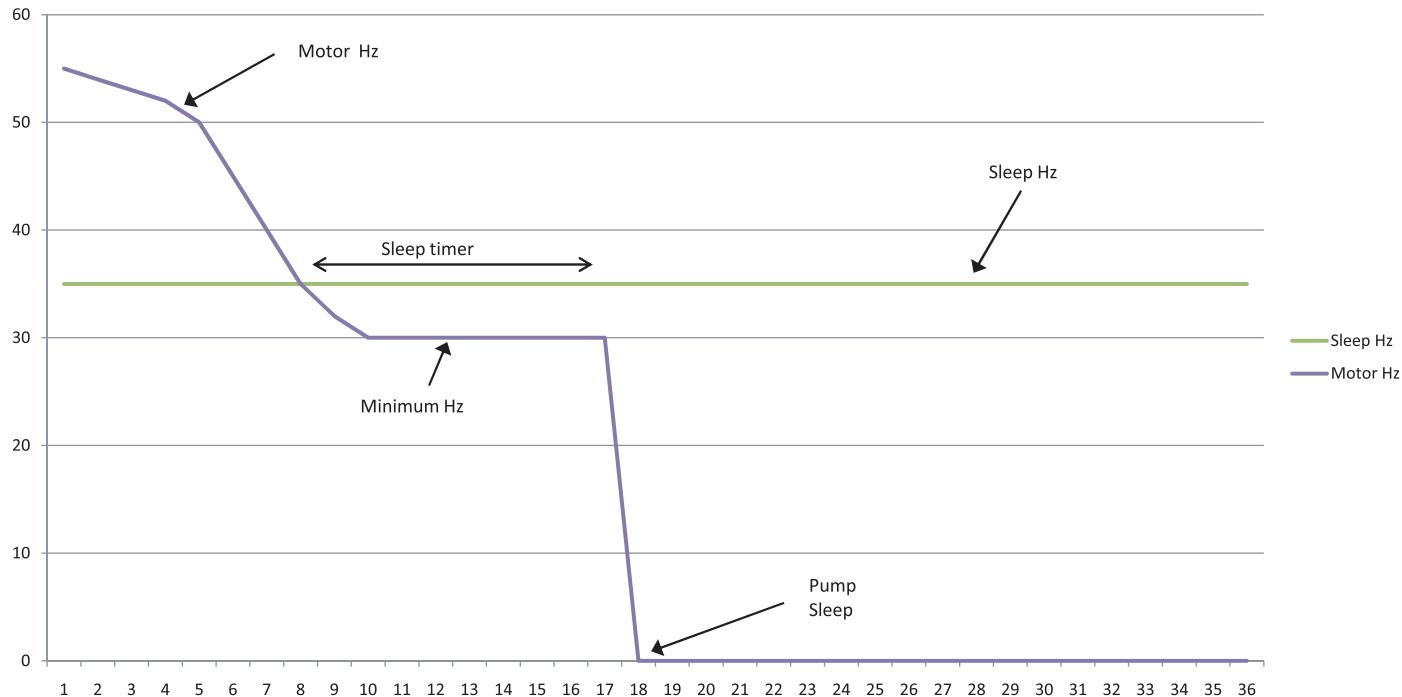

# Faults, Alarms and Warning Codes


FAULTS		ALARMS	
E.OC1	Overcurrent trip during acceleration	FN	Fan alarm
E.OC2	Overcurrent trip during constant speed	E---	Faults history
E.OC3	Overcurrent trip during deceleration	HOLD	Operation panel lock
E.OV1	Regenerative overvoltage	Er1 to 4	Parameter write error
E.OV2	Regenerative overvoltage	Err.	Error
E.OV3	Regenerative overvoltage trip		
E.THT	Inverter overload trip	WARNINGS	
E.THM	Motor overload trip	OL	Stall prevention overcurrent
E.FIN	Fin overheat	oL	Stall prevention overvoltage
E.BE	Brake transistor alarm	RB	Regenerative brake prealarm
E.ILF	Input phase loss	TH	Electronic thermal relay function prealarm
E.OLT	Stall prevention	PS	PU stop
E.GF	Output side earth (ground)	MT	Maintenance signal output
E.LF	Output phase loss	UV	Undervoltage
E.OHT	External thermal relay trip	SA	Safety Stop
E.PTC	PTC thermistor operation		
E.PE	Parameter storage device		
E.PUE	PU disconnection		
E.RET	Retry count excess		
E. 5	CPU Fault		
E. 6	CPU Fault		
E. 7	CPU Fault		
E.CPU	CPU Fault		
E.CTE	CPU Fault		
E.CDO	Output current detection		
E.IOH	Inrush current limit circuit		
E.AIE	Analog input fault		
E.SAF	Safety circuit fault		

**IMPORTANT:**


*Faults can be reset by pressing the STOP/RESET button on the VFD. The selector switch must be in the “OFF” position to reset fault. Please contact your distributor if you are not able to reset a fault.*

# Terminal Connections —

## CP3R 1.5 & 3 HP PANELS

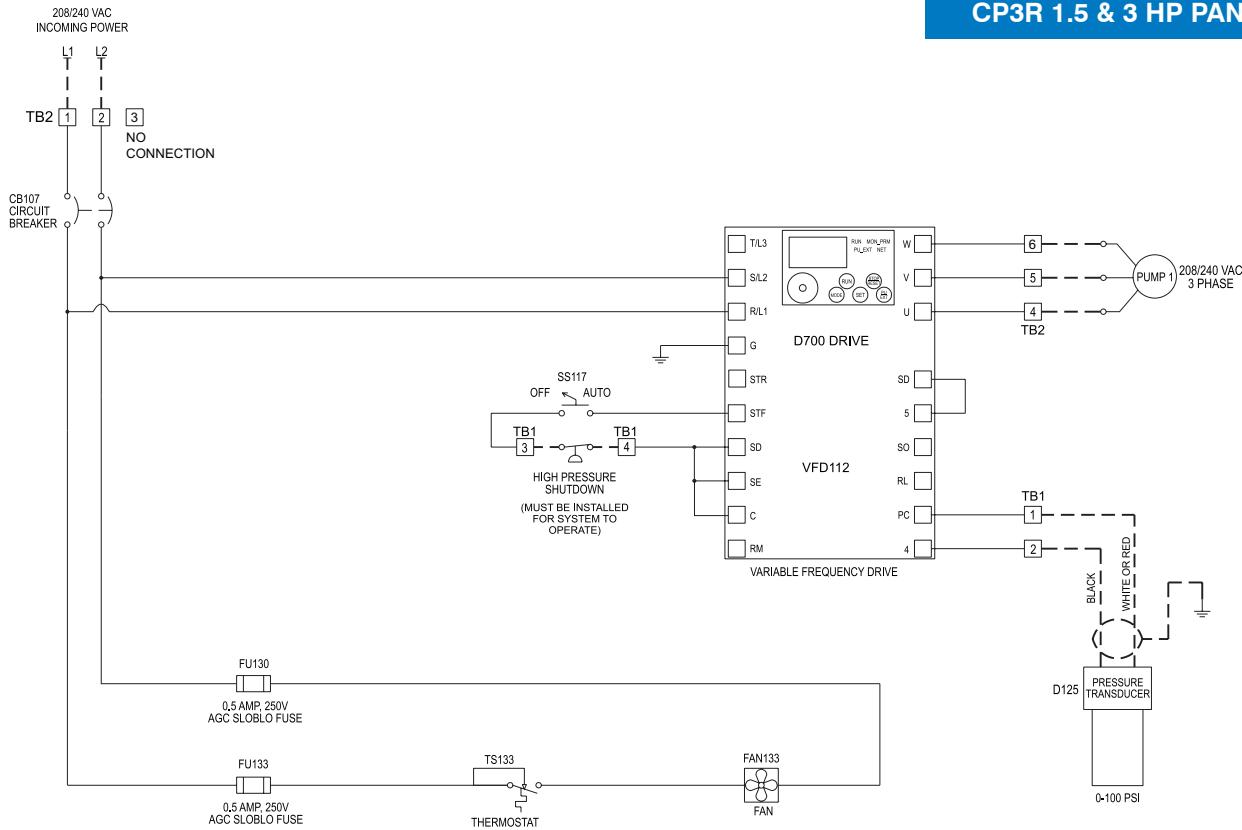

## CP3R 5 HP PANEL

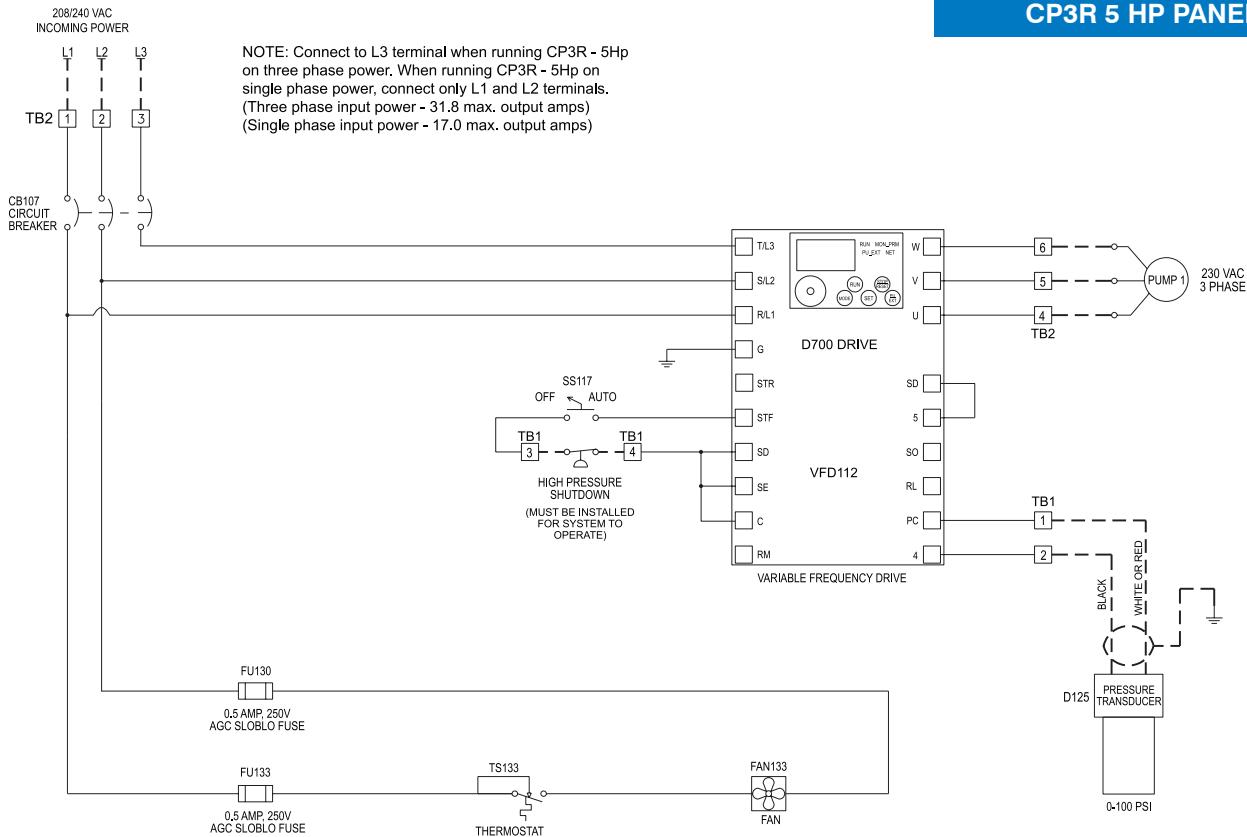

**NOTES:** \_\_\_\_\_



# SJE RHOMBUS.®

Technical support: +1-800-746-6287

techsupport@sjeinc.com

[www.sjerhombus.com](http://www.sjerhombus.com)

Technical Support Hours: Monday-Friday, 7 A.M. to 6 P.M. Central Time

PN 1030953F 10/20 © 2013 SJE, Inc. All Rights Reserved. SJE RHOMBUS is a trademark of SJE, Inc.